


CHELCO SPECIFICATIONS FOR SINGLE PHASE UNDERGROUND TEMPORARY METER POLE

NOTES:

- (1) A SINGLE 8' TREATED 4X4 POST (MINIMUM), 3' DEEP AND 5' ABOVE FINAL GRADE
- (2) 100 OR 200 AMP METER BASE AND PANEL (TO BE RAIN TIGHT) OR 200 AMP POWER PANEL CAN BE USED (IF POWER PANEL IS USED MUST HAVE CHASE ON LEFT SIDE FOR CHELCO WIRE FEED)
- (3) CONSUMER MUST INSTALL WIRE FROM BOTTOM OF PANEL TO BASE OF CHELCO EQUIPMENT LEAVING 6' TO 8' COILED WITHIN 3' OF CHELCO EQUIPMENT
- (4) THIS METER POLE FOR TEMPORARY CONSTRUCTION POWER AND NOT TO BE USED FOR PERMANENT SERVICE
- (5) ALWAYS CALL 811 BEFORE DIGGING
- (6) CONTACT YOUR COUNTY BUILDING DEPARTMENT FOR LOCAL BUILDING CODES

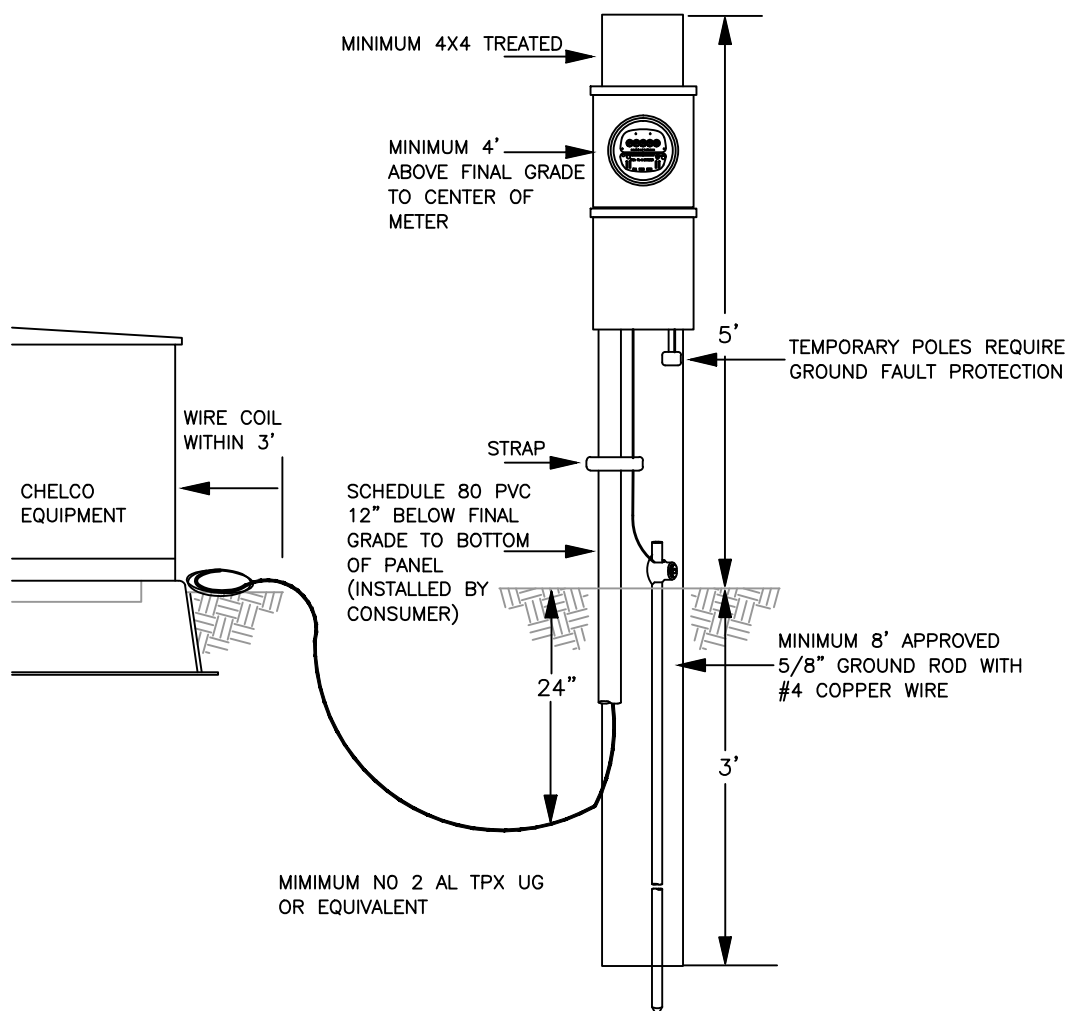

SPECIFICATIONS FOR SINGLE PHASE UNDERGROUND TEMPORARY METER POLE

DEC. 2013

CHELCO